

0RXQWLQJ	3DQHO PRXQW
: HLJKW	JP

Terminal connections



Dimensions (All are in mm)

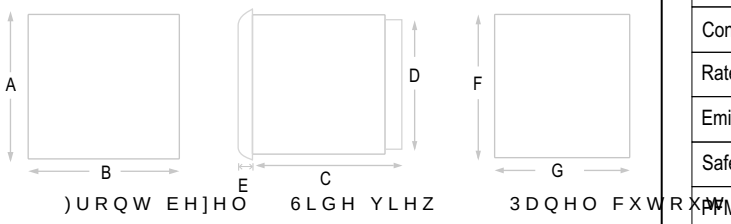

)URQW EH]HO 6LGH YLHZ 3DQHO FXWRXW


DIM	A	B	C	D	E	F	G
XTC562							

Compliance


Category	Reference standards	Testing level
Electrostatic discharge	IEC 61000-4-2	Level-3
Electrical fast transient / Brust	IEC 61000-4-4	Level-3
Electromagnetic field	IEC 61000-4-3	Level-3
Surge	IEC 61000-4-5	Level-3
Conducted RF	IEC 61000-4-6	Level-2
Rated power frequency	IEC 61000-4-8	Level-4
Voltage dip / Short interruptions	IEC 61000-4-11	Level-3
Conducted emissions	CISPR-11	Class-B
Rated emissions	CISPR-22	Class-A
Emission & Immunity	IEC 61326-1	
Safety	IEC 61010-1	
PFMF (Passing criteria)	IEC 61000-4-8	Class A

Timing diagrams


1. On delay, Interval modes:

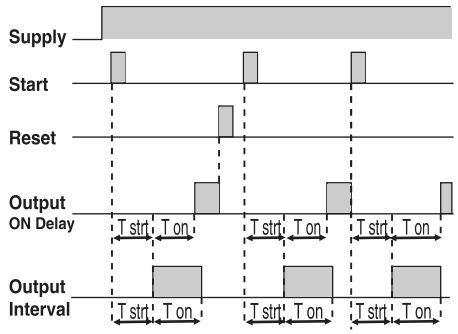


2. Instantaneous + Delayed at start pulse:

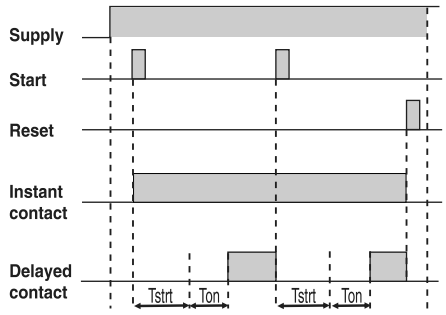


3. Cyclic ON first, Cyclic OFF first modes:

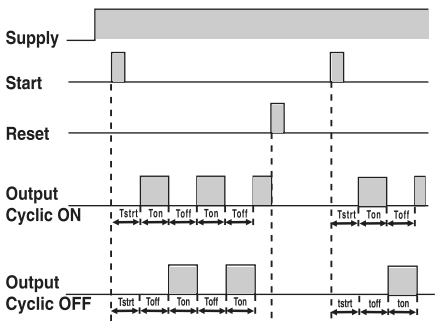

4. Instantaneous + Delayed at power on:

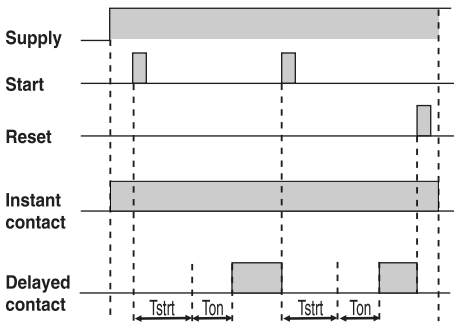


5. Motor reverse mode:

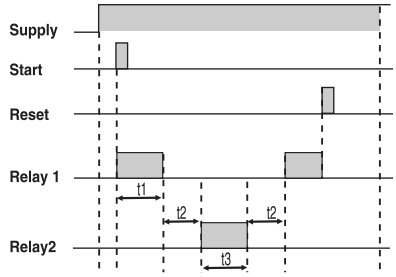


t1 = On time of relay1, t3 = On time of relay2,
t2 = Pause time

6. Motor reverse manual mode:

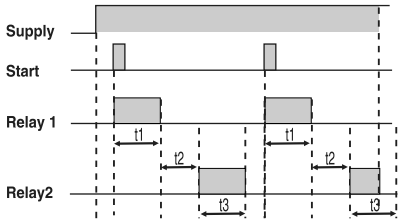


t1 = On time of relay1, t3 = On time of relay2,
t2 = Pause time

7. Batch mode

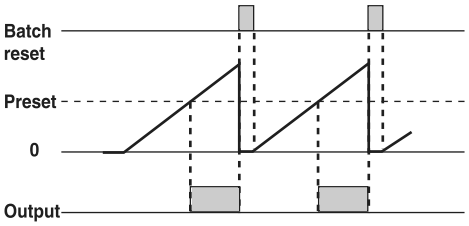


Batch mode

8. Typical application of Continuous start and reset and in On delay mode :

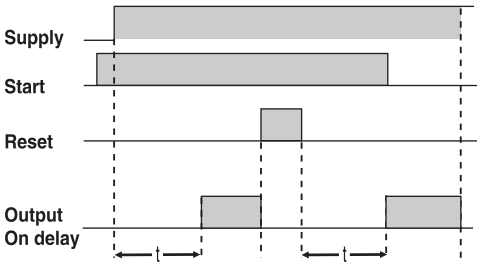


9. Typical application of Gate start in On delay mode :

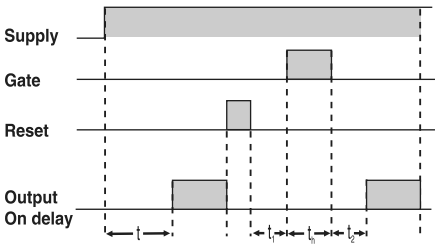

$t_1 + t_2 = t$ (set time), t_h = hold time.

10. Typical application of Level start in On delay mode :

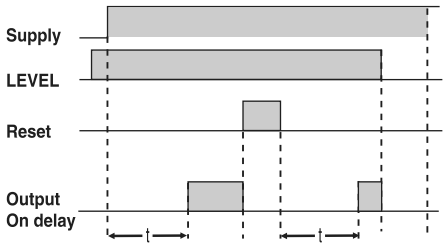

Ordering information

XTC562	5 (/ $< $	5 (/ $< $	W R 9 $ & ' &	